

Review of Power Sharing Control Strategies for Islanding Operation of AC Microgrids

Hua Han, Xiaochao Hou, Jian Yang, *Member, IEEE*, Jifa Wu, Mei Su, and Josep M. Guerrero, *Fellow, IEEE*

Abstract—Microgrid is a new concept for future energy distribution system that enables renewable energy integration. It generally consists of multiple distributed generators that are usually interfaced to the grid through power inverters. For the islanding operation of ac microgrids, two important tasks are to share the load demand among multiple parallel connected inverters proportionately, and maintain the voltage and frequency stabilities. This paper reviews and categorizes various approaches of power sharing control principles. Simultaneously, the control schemes are graphically illustrated. Moreover, various control approaches are compared in terms of their respective advantages and disadvantages. Finally, this paper presents the future trends.

Index Terms—AC microgrid, islanding operation, power electronic inverters, power sharing control strategies.

I. INTRODUCTION

WITH THE expansion of the electrical power grid, conventional power system has become increasingly vulnerable to cope with the reliability requirements and the diverse demand of power users. Moreover, distributed generation (DG) has advantages of pollution reduction, high-energy utilization rate, flexible installation location, and low-power transmission losses. DG units also present a higher degree of controllability and operability compared to the conventional generators [1], which will allow microgrids to play a major and critical role in maintaining the stability of electrical networks [2]–[4]. So, microgrids will gradually be a strong and effective support for the main power grid and potentially one of the future trends of power system [5].

The DG units of a microgrid can be classified into grid-forming (voltage-controlled) and grid-following (current controlled) DG units [6]. In grid-connected mode, the units are often controlled as grid-following. The most adopted control strategies for grid-following inverters are discussed in [4] and [7]–[9]. In islanding mode, the electronic converter

interfaces between the loads and the micro-source act as voltage sources, which are responsible for the power sharing according to their ratings and availability of power from their corresponding energy sources or prime movers [10]–[15].

This paper focuses on control strategies of grid-forming DG units in islanding mode. Researches on control of grid forming units were performed initially in uninterruptible power supply systems with parallel operation [16]–[21]. Power sharing control strategies of DG units based on communication include concentrated control [22]–[27], master/slave control [28]–[31], and distributed control [24], [32], [33]. On the other hand, the control strategies without communication are generally based on the droop concept, which include four main categories: 1) conventional and variants of the droop control [16], [34]–[60]; 2) virtual framework structure-based method [6], [19], [53], [61]–[68]; 3) “construct and compensate” based methods [69]–[76]; and 4) the hybrid droop/signal injection method [36], [77]. The details and characters of various control methods will be illustrated later.

Integrated control strategies refer to hierarchical structures which usually consist of primary, secondary, and tertiary control [22], [61], [62], [78]. The primary control stabilizes the voltage and frequency and offers plug-and-play capability for DGs. The secondary control, as a centralized controller, compensates for the voltage and frequency deviations to enhance the power quality. Tertiary control considers the optimal power flowing of the whole microgrids or interaction with main grid [12]. In addition, hierarchical control has other special functions: 1) distributed intelligent management system [79]; 2) voltage unbalance compensation for optimal power quality [80]; 3) self-healing networks [81]; 4) smart home with a cost-effective energy ecosystem [82]; and 5) generation scheduling [83]. So, the hierarchical structure of microgrids can be regarded as an intelligent, integrated, and multiagent system.

Some reviews of microgrid control have been published recently [84]–[87]. Reference [84] classifies all the control strategies (e.g., decentralized control, centralized control, model predictive control, and multiagent systems) into three levels: 1) primary; 2) secondary; and 3) tertiary based on their speed of response and infrastructure requirements. The most excellent is that it proposes the future challenges and trends in microgrid control. In [85], the next generation power system might adopt the distributed control techniques because of dividing the control task among different units. The characters of the distributed control are to use extensive integrated communication and advanced components. New family of

Manuscript received September 14, 2014; revised October 16, 2014 and March 30, 2015; accepted May 4, 2015. Date of publication June 10, 2015; date of current version December 19, 2015. This work was supported by the National Natural Science Foundation of China under Grant 61174125 and Grant 61203031. Paper no. TSG-00803-2014. (*Corresponding author: Jian Yang.*)

H. Han, X. Hou, J. Yang, J. Wu, and M. Su, are with the School of Information Science and Engineering, Central South University, Changsha 410083, China (e-mail: jian.yang@csu.edu.cn).

J. M. Guerrero is with the Department of Energy Technology, Aalborg University, Aalborg 9220, Denmark (e-mail: joz@et.aau.dk).

Color versions of one or more of the figures in this paper are available online at <http://ieeexplore.ieee.org>.

Digital Object Identifier 10.1109/TSG.2015.2434849

microgrid control and management strategies realizes the plug-and-play concept and the dynamics of the frequency in [86]. Reference [87] discusses the control methods and objectives from the point of the voltage and frequency stability, and presents the factors affecting power load sharing. This paper focus on the inverter output control and power sharing control which mostly belong to the primary control, especially for the droop-based control. Mostly, the decentralized control strategies are classed into four main categories more exactly.

The rest of this paper is organized as follows. Section II discusses three control methods based on communication. Section III presents the droop control methods, including the different variations. Section IV introduces several virtual structures techniques. Section V shows some construction and compensation methods. Hybrid droop/signal injection-based methods are reviewed in Section VI. Then, characters of various methods and the future trends are summarized in Section VII. Finally, this paper concludes in Section VIII.

II. COMMUNICATION-BASED CONTROL TECHNIQUES

Communication-based control techniques can achieve excellent voltage regulation and proper power sharing. Moreover, in contrast to droop controllers, which will be discussed later, the output voltage amplitude and frequency are generally close to their ratings without using a secondary control [22]. However, these control strategies, which require communication lines between the modules, result in increased cost of the system. Long distance communication lines will be easier to get interfered, thus reducing system reliability and expandability. In the following section, several typical communication-based control strategies are reviewed.

A. Concentrated Control

The concentrated/central control method is presented in [23]–[27] and [88], and the control scheme is illustrated in Fig. 1. The control method requires common synchronization signals and current sharing modules. The phase locked loop (PLL) circuit of each module can ensure the consistency between the frequency and phase of the output voltage and the synchronization signal. Also, the current sharing modules can detect the total load, which define the reference value of the current for each module. This reference current i_{ref} is a fraction of the load current i_{load} . For N equal modules, $i_{\text{ref}} = i_{\text{load}}/N$. In the meantime, every inverter unit measures itself output current in order to calculate the current error. In case of parallel units controlled by synchronization signals, they have negligible differences of frequency and phase among each other, thus the current sharing error of each unit can be caused by voltage amplitude inaccuracies. Therefore, this method directly adds current error to each inverter unit as a compensation component of the voltage reference in order to eliminate the differences among their output currents.

In [26] and [27], the central limit control (CLC) scheme is discussed. In CLC mode, all the modules should have the same configuration and each module tracks the average current to achieve equal current distribution. Reference [88] proposes

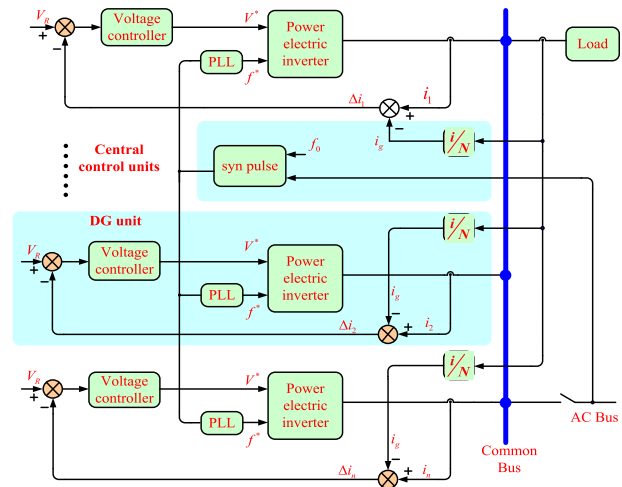


Fig. 1. Control schematic of the concentrated control.

a multistage centralized control scheme with high penetration of plug-in electric vehicles (PEVs). The coordination allows the PEVs to play a pivotal role in the successful and optimized operation of the islanded microgrids.

The one advantage of the concentrated method is that current sharing is maintained during both steady-state and transients. However, this control scheme must include a centralized controller, which makes difficult to expand the system and reduces system redundancies. Moreover, current reference has to be distributed to all converters by using high-bandwidth communication links, in order to achieve synchronization among the units. These techniques present high dependency on communications and reduce the reliability, which may be compromised with single-point faults.

B. Master/Slave Control

Based on the master/slave control method, the function of parallel control units is built into each inverter. Through the mode-selecting switch or automatic software setting, the initially starting module in parallel acts as master inverter, which is in charge of parallel control, while the others serve as slave-inverters [28]–[31], [89]. The structure of “master/slave” control is illustrated in Fig. 2. As shown in this figure, the master module regulates the output voltage and specifies the current reference of the rest of slave modules. Then, slave units track the current reference provided by the master in order to achieve equal current distribution. Inverters do not need any PLL for synchronization since these units are communicated with the master units. However, the system is not redundant since it presents a single point of failure. If master unit fails, the whole system will fail.

In order to overcome this drawback, several researchers have improved the master/slave control method. In [30], the rotating priority window, providing random selection of the master, is proposed to increase the reliability. An auto master–slave control strategy is proposed in [31], which is a variant of the master/slave control. The control circuitry contains an active power share bus and a reactive power share communication bus interconnecting all the paralleled units. The inverter with

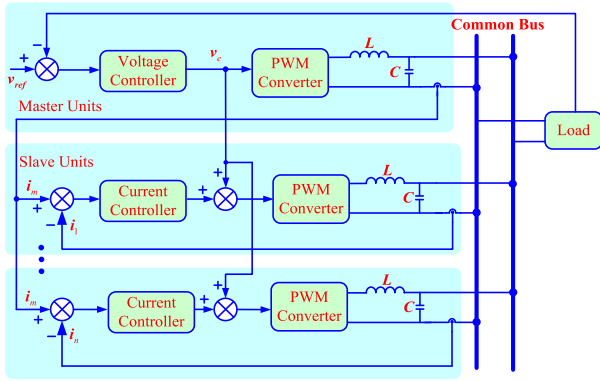


Fig. 2. Control structure of the master/slave control.

the highest output power becomes the master inverter, which drives the power bus. Also, its power is the reference for the other inverters. The master–slave control in [89] regards the utility interface as master control at the common coupling point with the utility and the energy gateways, allows plug-and-play integration of distributed energy resources and ensures efficient and reliable operation of the microgrid in every operating condition.

In summary, master/slave control can achieve excellent power sharing performance with advantages of ease implementation. If the master inverter fails, the improved control strategy would switch to another normal inverter which is then used as the new master. Therefore, parallel operation would not be affected. However, an obvious issue with all master/slave control methods is that high-output current overshoot may occur during transients since the master output current is not controlled, so it does not ensure a good transient performance.

C. Distributed Control

The distributed control is often applied to parallel converters [24], [32], [33], [90]–[93]. The instantaneous average current sharing is a typically distributed control for parallel converters. In this control technique, individual control circuit is used in each inverter, but no central controller is needed. Further, average current sharing requires a current sharing bus and reference synchronization for the voltage. An additional current control loop is used to enforce each converter to track the same average reference current, provided by the current sharing bus. When a defect happen in any module, it can smoothly detach from the microgrid, and the rest of modules can still operate normally in parallel. Fig. 3 shows a control block diagram of the distributed control scheme. The average current sharing bus value is regarded as a current reference of each paralleled converter. The current error i_{en} is decomposed into active and reactive components, i_{end} and i_{enq} , then the output voltage frequency and amplitude are regulated through current regulators, respectively.

The distinct feature of the distributed control is that the information required is not global but adjacent for any units. So, it only needs lower band-width than the central control method. Because of dividing the control task among different

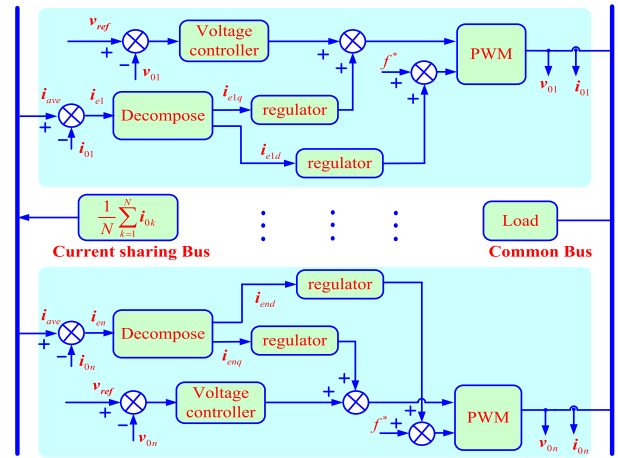


Fig. 3. Control structure of the distributed control.

units, it has many advantages compared to the droop control. Recently, it has become the flexible and reliable control strategies of future trends. In [90], a distributed networked control system is used to restore the frequency and amplitude deviations and ensure reactive power sharing. Without relying on a central control, the failure of a single unit will not influence the normal operation of the whole system. Reference [91] provides a distributed two-layer control scheme for ac microgrids. The voltage/frequency and active/reactive powers are decoupled, regulated by the first and second layers, respectively. Reference [92] utilizes the fully distributed control scheme for frequency restoration and economic dispatch. The most advantage is that the DGs can share loads according to their increment costs. A robust distributed controller is designed for sharing active and reactive power in [93]. It use partial feedback linearization and ensure the robustness by considering structured uncertainties. The concept of the graph theory is also adopted.

In conclusion, the distributed control has no central control board and every module is symmetric. Voltage regulation and fundamental power sharing are well controlled. However, interconnections between the inverters are still necessary. This degrades the flexibility and redundancy of the system. As the number of parallel modules and distance of the interconnected lines increase, more interference is expected in the system.

III. DROOP CHARACTERISTIC-BASED TECHNIQUES

The control strategies that operate without interunit communications for power sharing control are based on droop concept [2], [3], [11], [16]–[21], [94]–[96]. Operation without communication links is often essential to connect remote inverters. It can avoid complexity and high costs, and improve redundancy and reliability requirements of a supervisory system. Also, such a system is easier to expand because of the plug-and-play feature of the modules which allows replacing one unit without stopping the whole system. Therefore, communication lines are often avoided especially for long distances and high-investment cost.

However, droop characteristic presents several drawbacks.

- 1) *Frequency and Voltage Deviations*: In islanding mode, the voltage and frequency of the microgrid are load-dependent. Steeper droop ensures better load sharing, yet results in larger frequency and voltage deviations, and even may cause instabilities in the microgrid. This is the inherent tradeoff between the frequency and voltage regulation and load sharing accuracy for the droop method [34].
- 2) *Harmonic Loads*: The original droop method focuses on fundamental power sharing but does not take harmonic sharing into account in the case of nonlinear loads. If it is not coped properly, it would lead to harmonic circulating currents and poor power quality. Moreover, the calculation and smoothing of active and reactive power take some delays, thus it presents a slow dynamic response [35], [36].
- 3) *Different and Unknown Line Impedances*: The line impedances between the paralleled converters also affect the power sharing performance. When the line impedances between the inverters and point of common coupling are different, it could result in a large circulating current and low precision of power sharing among inverters [37], [38].
- 4) *Fluctuant and Changeable Output Power of DGs*: Another drawback of the original droop method is the poor performance with renewable energy resources because the output active power of micro-source is usually fluctuant and changeable [39].

To overcome these drawbacks and minimize the circulating current under all situations, researchers have developed several improved droop control methods. These methods fall into four main categories: 1) conventional and variants of droop control; 2) virtual structure-based methods; 3) construct and compensate-based methods; and 4) hybrid droop/signal-injection-based methods.

Besides the above four main categories, the most recent control methods based on droop characteristic has emerged from [94]–[96]. In [94], drooping the virtual flux instead of the inverter output voltage can avoid the complicated inner multiloop feedback control and frequency-voltage deviations to some extent. Reference [95] presents a multivariable control topology, which offers a systematic and straight forward design approach with the loop shaping technique. It also realizes real power sharing by simultaneous drooping of both frequency and voltage amplitude, which enhances load sharing accuracy in resistive microgrids. The consensus-based droop control with sparse communication network obviously alleviates the effects of nonideal line impedances with better dynamical performances in [96].

This section will discuss conventional and improved droop controllers, and show the control schemes in detail.

A. Conventional Droop Control

The droop control method for the parallel connected inverters can avoid the dependency on communications. It is sometimes named as “wireless” control with no

interconnection between the inverters. However, it can lead to a confusion with the wireless communications in the sense of radiofrequency-based communications. The basic idea of this control level (also named primary control) is to mimic the behavior of a synchronous generator, which is to reduce the frequency as the active power increases. When the inverter output impedance is highly inductive, hence the active and reactive powers drawn to the bus can be expressed as

$$\begin{cases} P_i = \frac{VE_i}{X} \sin \phi \\ Q_i = \frac{VE_i \cos \phi - V^2}{X} \end{cases} \quad (1)$$

where X is the output reactance of an inverter, ϕ is the phase angle between the output voltage of the inverter and the voltage of the common bus, and E_i and V are the amplitude of the output voltage of the inverter and the grid voltage, respectively. It can be found that the active power is predominantly dependent on the power angle, while the reactive power mostly depends on the output voltage amplitude. This principle can be integrated in voltage source inverters (VSIs) by using the well-known P/Q droop method [16], [40], which can be expressed as

$$\begin{cases} f_i = f_{\text{rated}} - m_P \cdot (P_i - P_{\text{rated}}) \\ E_i = E_{\text{rated}} - n_Q \cdot (Q_i - Q_{\text{rated}}) \end{cases} \quad (2)$$

where i is the index representing each converter, f_{rated} and E_{rated} are the nominal frequency and voltage of the micro-source, respectively, P_i and Q_i are the average active and reactive power, P_{rated} and Q_{rated} are the nominal active and reactive power, respectively, and m_P and n_Q are the active and reactive droop slopes, respectively.

The choice of m_P and n_Q impacts the network stability, so they must be carefully and appropriately designed [41], [42]. Usually, the droops are coordinated to make each DG system supply apparent power proportional to its capacity [16]

$$\begin{cases} m_P = \frac{f_i - f_{\min}}{P_i - P_{i,\max}} \\ n_Q = \frac{E_{i,\max} - E_{i,\min}}{Q_{i,\min} - Q_{i,\max}} \end{cases} \quad (3)$$

The control algorithm with conventional droop control is illustrated in Fig. 4. The power stage consists of VSI with a LC filter and a coupling line inductor. The controller consist of three control loops.

- 1) A power sharing controller is used to generate the magnitude and frequency of the fundamental output voltage of the inverter according to the droop characteristic.
- 2) A voltage controller is used to synthesize the reference filter inductor current vector.
- 3) A current controller is adopted to generate the command voltage by a pulse width modulation module.

As discussed above, the conventional droop method can be implemented without communication between modules, and therefore is more reliable. However, it has some drawbacks as listed below.

- 1) *Multiple Control Objectives*: Since there is only one control variable for each droop characteristic, it is not

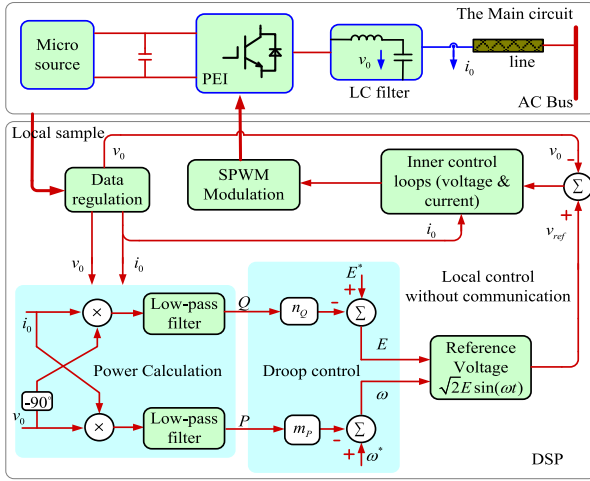


Fig. 4. Control structure of conventional P/f and Q/V droop control.

possible to satisfy multiple control objectives. For example, a design tradeoff needs to be considered between the voltage f/V regulations and load P/Q sharing [34].

- 2) *Mixed Resistive and Inductive Line Impedance*: The conventional droop method is developed assuming highly inductive equivalent impedance between the VSC and the ac bus. However, this assumption is challenged in microgrid applications since low-voltage distribution lines are mainly resistive. Therefore, (1) is not valid for ac microgrids [34], [38]. Furthermore, if the line impedance is mixed resistive and inductive, then the active and reactive power will be strongly coupled. This case is important in medium-voltage (MV) microgrids, in which the power lines X/R ratio can be next to one.
- 3) *Not a Global Voltage Variable*: As opposed to the frequency, the voltage is not a global variable in a microgrid. Thus, the reactive power control is difficult to share between the parallel inverters and may result in circulating reactive current [37], [38]. Same problem may occur in highly resistive lines, especially for circulation of active current controlled through the voltage.
- 4) *Nonlinear Loads*: In case of nonlinear loads, the conventional droop method is only based on fundamental values and does not consider current or voltage harmonics. Since it only uses P and Q measurements which are usually average over one line cycle. The conventional droop method should be modified in order to share the harmonic currents [35], [36].

These potential drawbacks have been widely discussed in [34]–[38]. Proposed solutions will be discussed in the following sections.

B. VPD/FQB Droop Control

While the conventional frequency droop control method works well in a microgrid with mainly inductive line impedances, it may present problems when implemented it on a low-voltage microgrid, where the feeder impedance is mainly resistive. Note that the delivered active and reactive power of the inverter still increase with E , but here, the reactive power

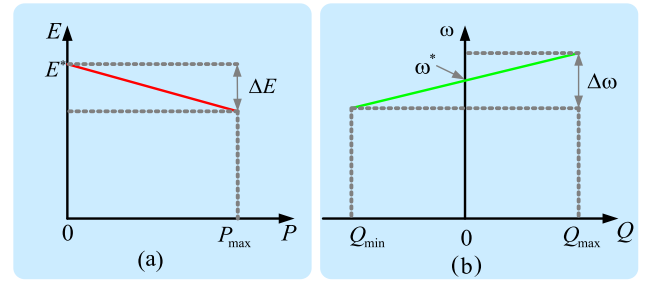


Fig. 5. Droop/boost characteristics for low-voltage ac microgrid. (a) VPD method. (b) FQB method.

increases with the power angle ϕ , and the active power remains increasing along with voltage variation ($E - V_{\text{com}}$), as can be seen in the following well known small-angle approximation:

$$\begin{cases} P \approx \frac{V_{\text{com}}E - V_{\text{com}}^2}{Z} \\ Q \approx -\frac{V_{\text{com}}E}{Z} \cdot \phi. \end{cases} \quad (4)$$

Thus, voltage active power droop and frequency reactive power boost (VPD/FQB) characteristics are alternatively considered [19], [46]–[48], as

$$\begin{cases} \omega_i = \omega_{\text{rated}} + m_Q \cdot Q_i \\ E_i = E_{\text{rated}} - n_P \cdot P_i. \end{cases} \quad (5)$$

Droop/boost characteristics of VPD/FQB method are shown in Fig. 5. This kind of control offers an improved performance for controlling low-voltage ac microgrid with highly resistive transmission lines [46]. However, the VPD/FQB method strongly depends on system parameters which significantly restrict its application. Furthermore, it is also unable to properly share the load active current.

C. Complex Line Impedance-Based Droop Method


Many problems cannot be solved by using the conventional droop control method, such as line impedance dependency, inaccurate P or Q regulation and slow transient response [34]–[38]. In [53], considering the impact of complex impedance, it proposes the controller that can simplify the coupled active and reactive power relationships, offer good dynamic performance, and be more convenient when the line impedance resistance and inductance parts are similar ($X \approx R$) in MV microgrids. In this particular case, the droop functions can be expressed as

$$\begin{cases} \omega = \omega_0 - m_P \cdot (P - Q) \\ E = E_0 - n_Q \cdot (P + Q). \end{cases} \quad (6)$$

In [52], to facilitate simultaneous active and reactive powers control and regulate the point of common coupling (PCC) voltage, a P - Q - V droop control method is proposed. For electric systems with complex impedance, both active and reactive powers affect the voltage magnitude. Therefore, the droop characteristics for the proposed P - Q - V droop method is given by

$$V = V_{\text{ref}} + (n_d \cdot P) + (m_d \cdot Q) \quad (7)$$

where V_{ref} is the desired reference value of the PCC voltage, in this case, 1 p.u.; n_d and m_d are the active and reactive power

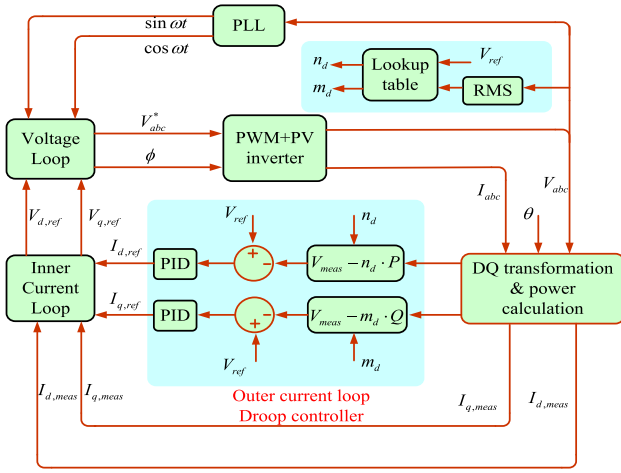Fig. 6. Control algorithm with the proposed P - Q - V droop method.

coefficients for the proposed P - Q - V droop method. Moreover, these droop coefficients are adjusted online through a lookup table based on the PCC voltage level. The control algorithm of the proposed P - Q - V droop method is shown in Fig. 6.

Furthermore, additional loops such as impedance voltage drops estimator [38], grid parameters estimator [54], and reactive current loop [55] have been added to the conventional droop control in order to deal with line impedance mismatches and ensure good power sharing performance.

In order to improve the dynamic performances of parallel inverters in DG systems, a “wireless”(droop) controller is proposed in [56]

$$\begin{cases} \phi = -m \cdot \int_{-\infty}^t P dt - m_p \cdot P - m_d \frac{dP}{dt} \\ E = E^* - n \cdot Q - n_d \cdot \frac{dQ}{dt} \end{cases} \quad (8)$$

In a relatively small ac microgrid, large load changes can be expected. Then an adaptive derivative term is used to add damping and to avoid large start-up transients and circulating currents [57], [58], as

$$\begin{cases} \omega = \omega^* + K_p \cdot (P_i - P_{i,ref}) + K_{pd} \frac{dP_i}{dt} \\ V_i = V_{ref} + K_Q \cdot (Q_i - Q_{i,ref}) + K_{qd} \frac{dQ_i}{dt} \end{cases} \quad (9)$$

where the choice of K_{pd} and K_{qd} can be obtained through the pole placement method.

Additionally, there are some other solutions to address dynamic response problems: droop based on coupling filter parameters [59], droop based on H_∞ derived from linear matrix inequality control theory [60].

D. Angle Droop Control

In further investigation of the droop concept, some researchers have proposed power-angle droop control, in which the phase angle of the distributed source voltage, relative to a system-wide common timing reference is set [43]–[45]. As a result, the power requirement can be distributed among DGs, similarly as conventional droop does,

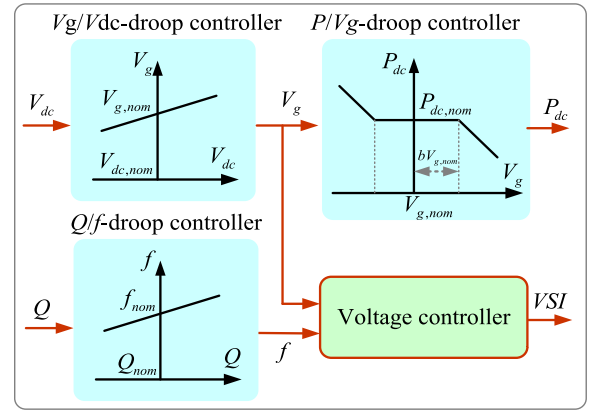


Fig. 7. Droop control with constant power band.

by dropping the voltage angle and magnitude

$$\begin{cases} \delta_i = \delta_{rated} - m_p \cdot (P_i - P_{i,rated}) \\ E_i = E_{rated} - n_Q \cdot (Q_i - Q_{i,rated}) \end{cases} \quad (10)$$

where E_{rated} and δ_{rated} are the rated voltage magnitude and angle of the DG, respectively, when supplying their rated power levels of $P_{i,rated}$ and $Q_{i,rated}$. Coefficients m_p and n_Q indicate active and reactive power droop gains. These values are chosen to meet voltage regulation requirement in the microgrid. The coefficient values for different DGs are chosen in order to share the load in proportion to their ratings.

The angle droop is able to provide proper load sharing among the DGs without a significant steady-state frequency drop in the system and it has advantages as the frequency maximum restricts the choice of droop gain in the conventional frequency droop control. Moreover, no communication is needed between DGs. However, if the local control boards are not synchronized each other, the imperfection of the crystal clock of the digital processors makes frequencies of each inverter slightly different, which will lead to running out of phase limits after certain time, leading to system instability. Some authors suggest the controller area network bus or even global positioning system to synchronize DGs. However, the loss of the global synchronizing signal at some DG units should be further investigated.

E. Voltage-Based Droop Control

This control method is another type of P/V control. The control strategy presents a constant power band control of islanding ac microgrid, which operates without interunit communication in a fully distributed manner and takes the specific characteristics of the microgrid into account. These characteristics include the lack of rotating inertia, resistive line, and high share of DGs, which are less controllable than central generators and require optimal power exploitation [49]–[51].

The voltage-based droop control strategy [49] consists of a P/V droop controller which is divided into two droop controllers (V_g/V_{dc} and P/V_g droops) and constant-power bands, as illustrated in Fig. 7.

First, the V_g/V_{dc} droop control principle is based on the specific characteristics of islanding ac microgrid. If an imbalance occurs between the generated power and the absorbed

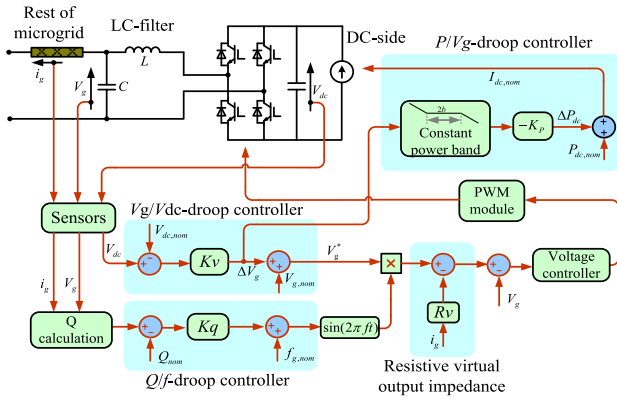


Fig. 8. Overall scheme of droop control with constant power band.

power, the dc link voltage V_{dc} of the power source changes. Therefore, V_{dc} is the indicator for ac power change

$$V_g^* = V_{g,nom} + m \cdot (V_{dc} - V_{dc,nom}) \quad (11)$$

where $V_{g,nom}$ and $V_{dc,nom}$ are the nominal voltage of ac and dc side of power converter. Note that a slightly change of V_g leads to a change of the power delivered to the electrical network. To limit the significant deviation of ac side voltage, P_{dc}/V_g droop with constant power band is used [49], as

$$P_{dc} = \begin{cases} P_{dc,nom} - K_P \cdot (V_g - (1+b) \cdot V_{g,nom}) & \text{if } V_g > (1+b)V_{g,nom} \\ P_{dc,nom} & \text{if } (1-b)V_{g,nom} < V_g < (1+b)V_{g,nom} \\ P_{dc,nom} - K_P \cdot (V_g - (1-b) \cdot V_{g,nom}) & \text{if } V_g < (1-b)V_{g,nom} \end{cases} \quad (12)$$

where $P_{dc,nom}$ is the rated active power of the ac-side of power converter, and K_P is the power droop gain. Note that the width b of this band is dependent on the nature of the source.

V_g/V_{dc} droop control can be used along with P_{dc}/V_g control in ac microgrids in order to take the advantages of both control methods. With the V_g/V_{dc} droop control, the microgrid voltage can be changed by detecting changes of V_{dc} , and balance is achieved without the need to change P_{dc} . In the meantime, frequent power changes can be avoided. No communication for the primary control is required, and the tolerated voltage deviation from its nominal value is effectively used for the control. The overall scheme of the droop control with constant power band is shown in Fig. 8.

In summary, voltage-based control strategy makes full utilization of the allowable range of the output voltage. In this range, the renewable energy sources are actively dispatched as they operate at maximum power tracking point. This is particularly advantageous for DGs since their energy can be used more efficiently. Additionally, by combining the P/V_g droop control, P_{dc} can be changed in case the constant power band is surpassed, which increases the power flexibility in ac microgrid and avoids the voltage-limit violation. However, this control requires the micro-source to have certain ability to dispatch energy easily. Therefore, DGs require the multistage controller to dispatch the energy, which may affect the system efficiency to some extent.

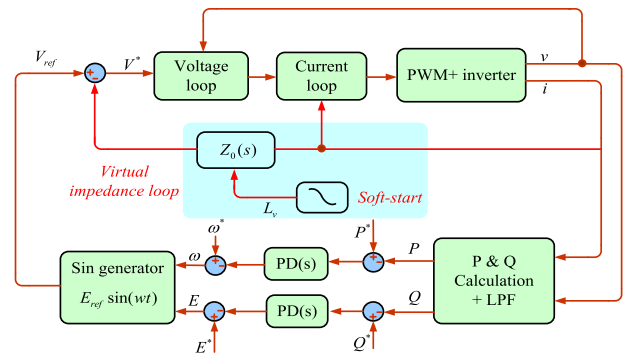


Fig. 9. Control scheme of droop control with virtual output impedance.

IV. VIRTUAL-STRUCTURE-BASED METHODS

A. Virtual Output Impedance Loop

In order to avoid the active and reactive power coupling, a typical and popular approach is based on virtual output impedance method [6], [19], [53], [61], [62]. This control method is implemented by including fast control loops in the droop control method, as shown in Fig. 9. As a result, the expected voltage can be modified [19], as

$$V_{ref} = V^* - Z_D(s) \cdot i_0 \quad (13)$$

where $Z_D(s)$ is the virtual output impedance, and V^* is the output voltage reference under no load condition. In general, the output inductance can be produced by emulating an inductive behavior. This can be achieved by drooping the output voltage proportionally to the derivative of the output current with respect to the time, so that $Z_D(s)$ is purely inductive, i.e., $Z_D(s) = sL_D$. However, differentiation can amplify high-frequency noise, which may destabilize the DG voltage control scheme, especially during transients. This issue can be overcome by using a low-pass filter instead of a pure derivative term of the output current [19]

$$V_{ref} = V^* - L_D \frac{s}{s + \omega_c} i_0. \quad (14)$$

If the virtual impedance $Z_D(s)$ is properly adjusted, it can prevent occurrence of current spikes when the DG is initially connected to the ac microgrid. The soft starting can be facilitated by considering the time-variant virtual output impedance, as

$$Z_D(t) = Z_f - (Z_f - Z_i)e^{-t/T} \quad (15)$$

where Z_i and Z_f are the initial and final values of the virtual output impedance, respectively, and T is the time constant of the soft starting process. Also, if the output inductance can be produced by emulating a resistive behavior, the system stability can be improved [64]. Recently, the virtual output impedance method has been modified for harmonic current sharing [63], which is introduced in the following section.

B. Enhanced Virtual Impedance Loop

The islanding ac microgrid may have serious power quality problems due to the increasing presence of nonlinear loads.

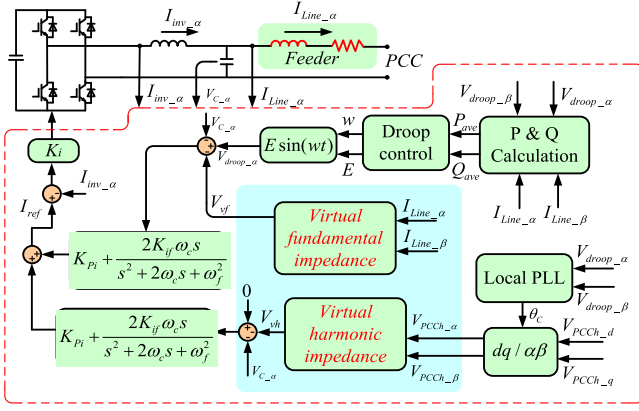


Fig. 10. Scheme of enhanced virtual impedance method.

To realize a better reactive and harmonic power sharing, He *et al.* [63] proposed an enhanced control method using virtual impedance at the fundamental and selected harmonic frequencies. Similar in virtual fundamental output impedance, this enhanced control method introduces the harmonic virtual impedance. The overall scheme of droop control with enhanced virtual impedance is shown in Fig. 10.

This enhanced virtual impedance control method can realize better reactive and harmonic power sharing, alleviate the computational load at DG unit local controller without using any fundamental and harmonic components extractions, and mitigate the PCC harmonic voltages by reducing the magnitude of DG unit equivalent harmonic impedance. However, it requires the knowledge of the physical line impedance parameters, and low-bandwidth communications.

Additionally, virtual impedance design rules are presented in [64], and a robust virtual impedance implementation is proposed, which can alleviate voltage distortion problems caused by harmonic loads.

C. Virtual Frame Transformation Method

Another method based on a virtual structure is the virtual frame transformation [6], [65]. In general, both line reactance X and resistance R need to be considered. The active and reactive powers drawn to the bus can be expressed as


$$\begin{cases} P_i \cong \frac{V}{Z}[(E_i - V) \cos \theta + E_i \phi \sin \theta] \\ Q_i \cong \frac{V}{Z}[(E_i - V) \sin \theta - E_i \phi \cos \theta] \end{cases} \quad (16)$$

where ϕ is the phase angle between the output voltage of the inverter and the common bus, E and V are the amplitude of the output voltage of the inverter and the grid voltage, Z and θ are the magnitude and phase of the impedance, respectively.

The use of an orthogonal linear rotational transformation matrix T from active and reactive power P and Q to the modified active and reactive power P' and Q' is proposed as

$$\begin{bmatrix} P' \\ Q' \end{bmatrix} = T_{PQ} \cdot \begin{bmatrix} P \\ Q \end{bmatrix} = \begin{bmatrix} \sin \theta & -\cos \theta \\ \cos \theta & \sin \theta \end{bmatrix} \cdot \begin{bmatrix} P \\ Q \end{bmatrix}. \quad (17)$$

Despite the line impedance is mixed, P/Q decoupling is achieved as if the network were purely inductive. In general,

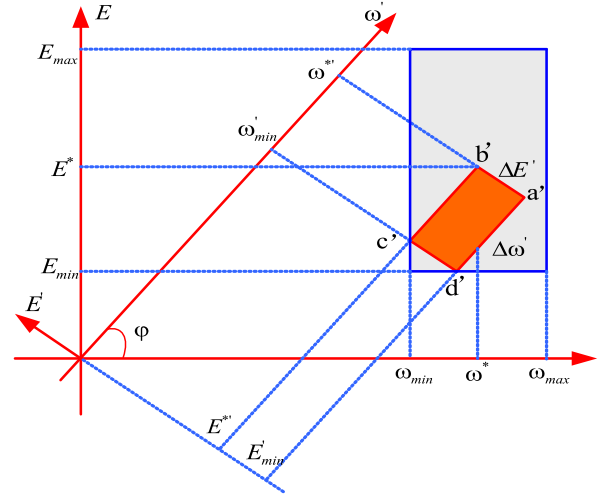Fig. 11. Details of the $\omega' - E'$ virtual frame transformation.

the accurate value R/X is not known, but an estimation of R/X may be sufficient to perform the method [54].

Similarly to [6] and [54], a virtual frequency/voltage frame transformation ($\omega' - E'$) is proposed in [66]–[68]

$$\begin{bmatrix} \omega' \\ E' \end{bmatrix} = T_{\omega E} \cdot \begin{bmatrix} \omega \\ E \end{bmatrix} = \begin{bmatrix} \sin \varphi & \cos \varphi \\ -\cos \varphi & \sin \varphi \end{bmatrix} \cdot \begin{bmatrix} \omega \\ E \end{bmatrix} \quad (18)$$

where E and ω are calculated through the conventional droop equations in (2). The transformed voltage and frequency, $E' - \omega'$, are then used as reference values for the DG voltage control loop. The VPD/FQB method and the conventional droop control are special cases where $\varphi = 0$ and $\varphi = 90^\circ$. The $\omega' - E'$ virtual frame transformation is shown in Fig. 11.

The proposed real and reactive power control is based on the virtual frequency and voltage $\omega' - E'$ frame, which can effectively decouple real and reactive power flows and improve the system transient and stability performance. However, one issue with the virtual frame power control is that if the frame transformation angle is not the same for all DG units, the microgrid frequency and voltage will be converted to different values in different virtual frames. Consequently, if two DGs are injecting different powers or line impedances are not matched, the transformation angle will be different and both reference frames will be out of synchronism.

V. CONSTRUCTION-AND-COMPENSATION-BASED METHODS

A. Adaptive Voltage Droop Control

Recently, some researchers have proposed control methods based on construction and compensation ideas. In [69], it proposes a novel adaptive voltage droop scheme for the parallel operation of DGs in an islanding ac microgrid. In this method, two terms are constructed to the conventional reactive power ($Q-V$) control. One term is used to compensate for the voltage drop across the transmission lines. The other term is added to hold the system stability and improve reactive power

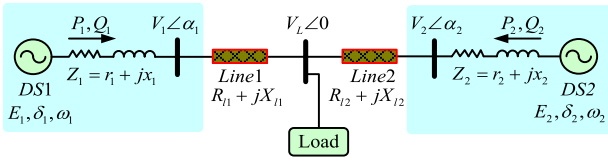


Fig. 12. Typical two-DGs system.

sharing under heavy loading conditions. In order to illustrate this control technique, a two-DG system with generic output impedances is shown in Fig. 12. The voltage of a single DG can be derived as

$$V_i = E_i^* - D_{Q_i} Q_i - \frac{r_i P_i}{E_i^*} - \frac{x_i Q_i}{E_i^*}. \quad (19)$$

The two latter terms represent the voltage drop on the internal line impedance. These terms can be added to the conventional reactive power control, which compensates for voltage drops on the power lines as

$$E_i = E_i^* - D_{Q_i} Q_i + \left(\frac{r_i P_i}{E_i^*} + \frac{x_i Q_i}{E_i^*} \right). \quad (20)$$

Additionally, to improve the system stability and suit for any load conditions, the method presented in [69] adopts the voltage droop coefficient as a nonlinear function of active and reactive power

$$\begin{cases} E_i = E_i^* - D_i(P_i, Q_i) \cdot Q_i + \left(\frac{r_i P_i}{E_i^*} + \frac{x_i Q_i}{E_i^*} \right) \\ D_i(P_i, Q_i) = D_{Q_i} + m_{Q_i} Q_i^2 + m_{P_i} P_i^2 \end{cases} \quad (21)$$

where D_{Q_i} , m_{Q_i} , and m_{P_i} are droop coefficients. The three terms can mitigate the negative impacts of the active power control and the microgrid parameters on the reactive power control, improving the system stability and the reactive power sharing under heavy loading conditions. Nevertheless, this method requires good knowledge of the power line parameters [69]. Small errors may result in a positive feedback, and thus may cause system instability.

B. Synchronized Reactive Power Compensation Method

To improve the reactive power sharing accuracy, an enhanced control strategy is proposed in [70] and [71], which estimates the reactive power control error by injecting a small real-power disturbance that is activated by low-bandwidth synchronization signals from the central controller. Also, a slow integration term is added to the conventional reactive power droop control in order to eliminate reactive power sharing error. With the proposed scheme, reactive power sharing errors are significantly reduced. After the compensation, the proposed droop controller will be automatically switched back to the conventional droop controller. The improved droop control can be described as

$$\begin{cases} \omega = \omega_0 - (D_P \cdot P + D_Q \cdot Q) \\ E = E_0 - D_Q \cdot Q + \left(\frac{K_C}{s} \right) \cdot (P - P_{AVE}) \end{cases} \quad (22)$$

where K_C is the integral gain, which is selected to be the same for all the DG units. Fig. 13 illustrates the diagram of the proposed synchronized reactive power compensation method. This control strategy is realized by two stages [71].

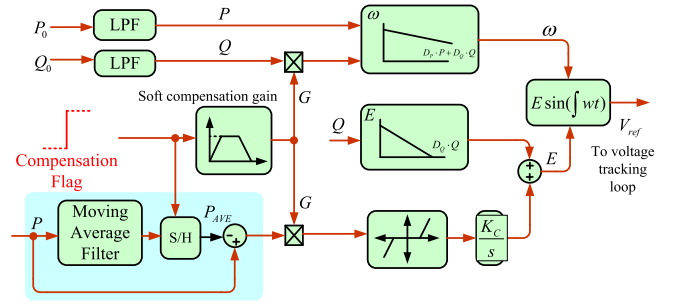


Fig. 13. Droop control with synchronized reactive power compensation.

The conventional droop method is used in the first stage, and the averaged real power in the steady-state should be measured for use in the second stage. In the last stage, the reactive power sharing error is compensated by introducing a real-reactive power coupling and using an integral voltage magnitude term.

In summary, the synchronized reactive power compensated method injects a real-reactive power transient coupling term to identify the errors of reactive power sharing, and improves the reactive power sharing accuracy [71]. However, the method needs synchronization signals from a central controller. It can be seen as a classical event-triggered system whose stability is not easy to be guaranteed.

C. Droop Control-Based Synchronized Operation

The method mainly includes two important operations: 1) error reduction operation; and 2) voltage recovery operation [100]. The sharing accuracy is improved by the sharing error reduction operation, which is activated by the low-bandwidth synchronization signals. However, the error reduction operation will result in a decrease in output voltage amplitude. Therefore, the voltage recovery operation is proposed to compensate the decrease. The needed communication in this method is very simple, and the plug-and-play is reserved. The improved droop control can be described as

$$E_i(t) = E^* - n_i Q_i(t) - \sum_{n=1}^{k-1} K_i Q_i^n + \sum_{n=1}^k G^n \Delta E \quad (23)$$

where k denotes the times of synchronization event until time t . According to (23), the control is a hybrid system with continuous and discrete traits. Therefore, the droop equation at the k th synchronization interval could be expressed as

$$E_i^k = E^* - n_i Q_i^k - \sum_{n=1}^{k-1} K_i Q_i^n + \sum_{n=1}^k G^n \Delta E \quad (24)$$

where G^n is the voltage recovery operation signal at the n th synchronization interval, G^n has two possible values: 1 or 0. If $G^n = 1$, it means the voltage recovery operation is performed. Q_i^n represents the output reactive power of DG- i unit at the n th synchronization interval. K_i is a compensation coefficient for the DG- i unit and ΔE is a constant value for voltage recovery [100]. Besides, the control timing diagram is shown in Fig. 14. The sharing error operation and the voltage recovery operation are performed in update interval. Sampling operation occurs in sampling interval. There is a time interval τ ,

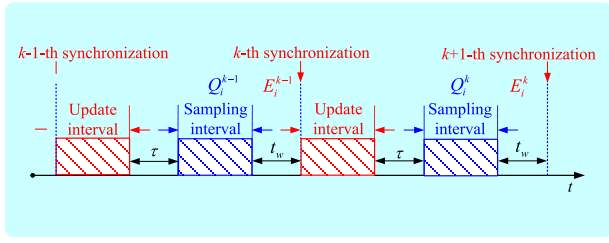


Fig. 14. Control timing diagram of one DG with the two consecutive synchronization events.

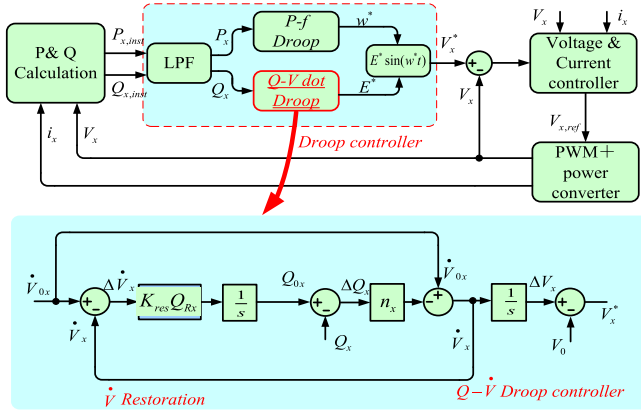


Fig. 15. $Q-\dot{V}$ droop controller and the control block diagram of single DG.

which is long enough to guarantee the system in steady state. The method is robust to the time delay because all the necessary operations only need to be completed in an interval, not a critical point.

D. $Q-\dot{V}$ Dot Droop Control Method

This method constructs the relationships of reactive power Q and the change rate of the DG output voltage (\dot{V}) in order to improve the reactive power sharing [72]–[74]. The proposed $Q-\dot{V}$ droop control can avoid this coupling dependence. The change rate of voltage will drive continuously until the desired Q flows, and its performance can be less dependent on the line impedances. The $Q-\dot{V}$ droop controller is expressed as

$$\begin{cases} \dot{V}_x = \dot{V}_{0x} - n_x \cdot (Q_{0x} - Q_x) \\ V_x^* = V_{0x} + \int_t \dot{V}_x d\tau \end{cases} \quad (25)$$

where n_x is the droop coefficient, \dot{V}_{0x} is the nominal \dot{V}_x which is set to zero, and Q_{0x} is the reactive power set point at the nominal \dot{V}_x , which is related to the reactive power capacity of DG. Also, V_{0x} is the nominal phase voltage magnitude and V_x^* is the voltage command. In the steady state, the \dot{V}_x must be reset back to zero to prevent varying output voltage magnitudes. So, \dot{V}_x restoration mechanism is designed [73] as

$$\frac{d}{dt} Q_{0x} = K_{res} \cdot Q_{Rx} \cdot (\dot{V}_{0x} - \dot{V}_x). \quad (26)$$

The control diagram of proposed $Q-\dot{V}$ droop control and the DG control block diagram are shown in Fig. 15.

In the proposed control strategy, the control result is related to the initial condition of the voltage change rate. Despite the

system is stability, the steady-state solutions may not exist. Moreover, the power sharing performances are not necessarily superior to those of conventional methods. The use of the integral term in (25), tries to restore the voltage with a local control loop, whose response will depend on the initial conditions of such an integrator, thus leading to system instability. Therefore, this controller is not feasible in real microgrid applications.

E. Common Variable-Based Control Method

The common variable is critical for the active and reactive power sharing. Because of the mismatch between the DG output interface inductors in microgrid, it is really difficult to achieve reactive power sharing. Similar with the active power control, some researchers have proposed the adjustable reactive power sharing method, where an integral controller is used to regulate the common bus voltage V_{com} [48], [75], [76]

$$E_i = K_q \int (V_{ref} - V_{com}) dt \quad (27)$$

where K_q is the integral gain and

$$V_{ref} = E^* - D_Q \cdot Q_i. \quad (28)$$

In the steady state, V_{com} and V_{ref} of each DG are equal. Moreover, the steady-state reactive power can be calculated as

$$Q = \frac{E^* - V_{com}}{D_Q}. \quad (29)$$

From (29), it is known that the reactive power for each DG is equal. Then, microgrid operation parameters will no longer affect the reactive power control. Similarly, the strategy proposed in [76] is suited for inverters with resistive output impedance. The improved active power control is modified

$$E_i = \int [K_e \cdot (E^* - V_{com}) - K_q \cdot P_i] dt. \quad (30)$$

In summary, the control method based on a common variable can achieve accurate proportional load sharing among parallel DGs, and is robust to the system parameter variations. However, these methods have a potential issue of requiring the load voltage information which is difficult to measure when it exists long distances between the DG and the common bus. Moreover, the common voltage may not exist when the configuration of ac microgrid is complex or in a real-distributed system with dispersed loads.

VI. HYBRID DROOP/SIGNAL-INJECTION-BASED METHOD

Conventional droop control cannot ensure a constant voltage and frequency, neither an exact power sharing. But an advantage of the control can avoid communication among the DGs. Communication-based control is a simple and stable strategy providing a good current sharing, yet a low reliability and redundancy. Therefore, to take advantage of their respective advantages, a hybrid scheme combining two control methods is presented in [47] and [97]–[99].

The sharing of real and reactive powers between the DGs is easily implemented by two independent control variables: 1) power angle; and 2) voltage amplitude. However, adding

TABLE I
POTENTIAL ADVANTAGES AND DISADVANTAGES OF THE COMMUNICATION-BASED CONTROL METHODS

Communication based control	Potential advantages	Potential disadvantages
Concentrated control [23]-[27]	<ul style="list-style-type: none"> ✓ Good power sharing in steady state and transients ✓ Constant voltage and frequency regulation 	<ul style="list-style-type: none"> ✗ High bandwidth communication required ✗ Low reliability and expandability
Master/slave control [28]-[31]	<ul style="list-style-type: none"> ✓ Recover the output voltage easily ✓ Good power sharing in steady state 	<ul style="list-style-type: none"> ✗ High current overshoot during transients ✗ Require high bandwidth communication ✗ Low redundancy
Distributed control [24], [32],[33]	<ul style="list-style-type: none"> ✓ Symmetrical for every module ✓ Constant voltage and fundamental power sharing. 	<ul style="list-style-type: none"> ✗ Require communication bus ✗ Degrade the modularity of the system

external communication is still not desired. Such communications increase the complexity and reduce the reliability, since power balance and system stability rely on these signals.

Several current sharing techniques based on frequency encoding of the current sharing information have been presented in [36] and [77]. The power lines are used for the communication for the power sharing. Most importantly, this technique does not require extra control interconnections and automatically compensates for inverter parameter variations and line impedance imbalances. In [36], each DG injects a small ac voltage signal to the microgrid. Frequency signal w_q is determined by the reactive power Q of the DG

$$w_q = w_{q0} + D_Q \cdot Q \quad (31)$$

where w_{q0} is the nominal frequency of injected ac signals and D_Q is the boost coefficient. The small real power transmitted through the signal injection is then calculated. And the value of the output voltage, E , is adjusted [36], as

$$E = E^* - D_P \cdot p_q \quad (32)$$

In this way, a Q/V droop is achieved, through the frequency component w_q . In the presence of nonlinear loads, the harmonic distortion D caused by nonlinear loads is shared in similar way. A control signal with a frequency that is drooped with D is injected. The power in this injected control signal is used to adjust the bandwidth of the voltage loop [36]

$$\begin{cases} \omega_d = \omega_{d0} - mD \\ D = \sqrt{S^2 - P^2} - Q^2 \\ BW = BW_0 - D_{bw} p_d \end{cases} \quad (33)$$

where BW_0 is the nominal bandwidth of the voltage loop and D_{bw} is the droop coefficient. The block diagram of the signal injection method is shown in Fig. 16.

Signal injection method properly controls the reactive power sharing and is not sensitive to variations in the line impedances [36], [77]. It is also suited for linear and nonlinear loads. However, it does not guarantee the voltage regulation. Other issues of this method are the complexity and the need for measuring and generating high-frequency components. Also, signal injection method can deteriorate the power quality, which increases the losses on the transmission lines because of the harmonic current generated by the method. Moreover, this injected signal can result in the inter-harmonic and resonance. Since this method adjusts the voltage

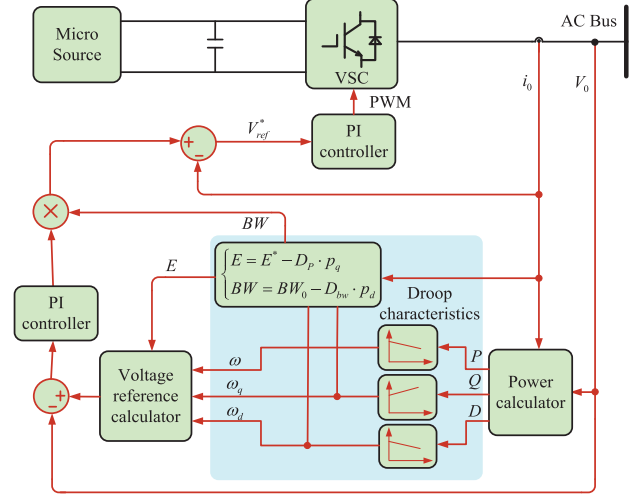


Fig. 16. Block diagram of the frequency signal injection method.

droop bandwidth, it may attenuate the system stability. As an alternative, harmonic virtual impedance is proposed in [63].

VII. DISCUSSION OF VARIOUS METHODS AND FUTURE TRENDS

From the previous discussion, it can be seen that each of these proposed control techniques has its own characteristics, advantages, and disadvantages. The communication-based methods can provide tight current sharing, high-power quality, fast transient response, and reduce circulating currents between the inverters. However, it requires communication links and high-bandwidth control loops. Further, it is not easy to be expanded due to the need for load current measurement and to know the number of inverters in the system. The required interconnections make the system less reliable and not truly redundant and distributed.

Droop control methods are based on local measurements of the network state variables which make DG truly distributed and absolute redundancy, as they do not depend on cables for reliable operation. It has many desirable features such as expandability, modularity, flexibility, and redundancy [61], [62], [78]. However, the droop control concept has some limitation including frequency and amplitude deviations, slow transient response and the possibility of circulating current among inverters due to line impedance mismatches between inverters and the common bus.

TABLE II
POTENTIAL ADVANTAGES AND DRAWBACKS OF DROOP CHARACTERISTIC-BASED CONTROL METHODS

Droop characteristic based control		Potential advantages	Potential drawbacks
Conventional and variants on droop control	Conventional frequent droop control [16],[40]	<ul style="list-style-type: none"> ✓ Easy implementation without communication ✓ High expandability, modularity and flexibility 	<ul style="list-style-type: none"> ✗ Affected by the physical parameters ✗ Poor voltage-frequency regulation ✗ Slow dynamic response ✗ Poor harmonic sharing
	VPD/FQB droop control [19],[46]-[48]	<ul style="list-style-type: none"> ✓ For highly resistive transmission lines ✓ Easy implementation without communication 	<ul style="list-style-type: none"> ✗ Affected by the physical parameters ✗ Poor voltage and frequency regulation
	Complex line impedance [52]-[58]	<ul style="list-style-type: none"> ✓ Decoupled active and reactive controls ✓ Improved voltage regulation 	<ul style="list-style-type: none"> ✗ Line impedances should be known in advance
	Angle droop control [43]-[45]	<ul style="list-style-type: none"> ✓ Constant frequency regulation 	<ul style="list-style-type: none"> ✗ Require GPS signals ✗ Poor performance of power sharing
	Droop control with constant power band [49]-[51]	<ul style="list-style-type: none"> ✓ Considering the specific characteristic of micro-source ✓ Operating in MPPT within a certain range and energy used more efficiently ✓ Avoiding voltage-limit violation 	<ul style="list-style-type: none"> ✗ Micro-source requires dispatched abilities ✗ Require multi-stages controllers and affect system efficiency
Virtual structure based method	Virtual output impedance control [19],[53],[61]-[62]	<ul style="list-style-type: none"> ✓ Not affected by the physical parameters ✓ Improved performance of power sharing and system stability 	<ul style="list-style-type: none"> ✗ Voltage regulation isn't guaranteed ✗ Requires relatively high bandwidth for controller
	Enhanced virtual impedance control [63]	<ul style="list-style-type: none"> ✓ Can handle linear and nonlinear loads power sharing ✓ Mitigates the PCC harmonic voltage 	<ul style="list-style-type: none"> ✗ Requires the low-bandwidth communication ✗ The physical parameters should be known in advance
	Virtual frame transformation method [6],[65]-[68]	<ul style="list-style-type: none"> ✓ Decoupled active and reactive power controls 	<ul style="list-style-type: none"> ✗ Hard to exactly ensure the same transformation angle for all DGs ✗ The physical parameters should be known in advance
Constructed and Compensated based method	Adaptive voltage droop control [69]	<ul style="list-style-type: none"> ✓ Improved voltage regulation ✓ Improved system stability and power sharing under heavy load condition 	<ul style="list-style-type: none"> ✗ The physical parameters should be known in advance
	Synchronized reactive power compensation [70]-[71]	<ul style="list-style-type: none"> ✓ Improved power sharing performances ✓ Not influenced by the physical parameters 	<ul style="list-style-type: none"> ✗ Requires the low bandwidth synchronized communication
	Droop control based Synchronized operations [82]	<ul style="list-style-type: none"> ✓ Improved power sharing performances ✓ Not affected by the physical parameters ✓ Robust to communication delay 	<ul style="list-style-type: none"> ✗ Requires the simple low bandwidth synchronized communication
	$Q-V$ dot control method [72]-[74]	<ul style="list-style-type: none"> ✓ Same as conventional droop 	<ul style="list-style-type: none"> ✗ Depend on the initial conditions ✗ Steady-state solution may not exist ✗ Easy to destabilize
Common variable based control method [48],[75],[76]		<ul style="list-style-type: none"> ✓ Accurate reactive power sharing ✓ Not affected by the physical parameters 	<ul style="list-style-type: none"> ✗ Hard to measure the common voltage due to long distance
Signal injection method [36],[77]		<ul style="list-style-type: none"> ✓ Can handle linear and nonlinear loads ✓ Not affected by the system parameters 	<ul style="list-style-type: none"> ✗ Cause harmonic distortion of voltage

Recently, researchers have improved the two control strategies, or combined these two control method to overcome the corresponding drawbacks. The potential advantages and disadvantages of the communication-based methods and the droop methods are summarized in Tables I and II. From these two tables, it is difficult for only one control scheme to overcome all drawbacks for all applications. However, further investigation of these control techniques will help improve the design and implementation of future distributed ac microgrid architectures.

The future trends in control strategies for microgrid are essentially related to energy services and protection, which

include the demand response, optimal power flow, market participation, storage management, and so on. These technologies could be interesting when connecting microgrids to the main grid or when deploying a cluster of multiple microgrids. Thus, multiagent systems and hierarchical control [62] could negotiate the interchange of energy between microgrids or microgrid clusters. Therefore, the multiagent control and hierarchical control are becoming a clear trend of research in microgrids technologies, while communication systems are becoming more important to make these applications feasible. In addition, the research about the impacts of stability and reliability with a large number of microgrids connection

are still behind. So, it is also difficult to convert the current conventional distribution network structure in short time. The details of future trends include the following.

- 1) *Network-Based Hybrid Distributed Control*: Smart distributed grid has been proved that it can improve the efficiency and reliability of the power system. Network-based hybrid distributed control of microgrids is essential to optimize the performance of microgrids under high-penetration level of DG resources, which is treated by algebraic graph theory. A converge analyses are carried out in [101], and it proposes a control scheme which cannot only realize frequency recovery, accurate power sharing, high reliability and robustness, but also optimize the energy flow in the system.
- 2) *Fault-Tolerant Control*: The fault-tolerant control is a key technology area which should not only manage supply and demand of electricity more effectively, but also apply appropriate corrective actions to eliminate, mitigate, and prevent various emergency situations such as faults, outages, disturbances to power quality or changes in the user needs [102]. Moreover, the fault tolerant control also can be implemented for self-healing and anti-islanding which enhances the capability of fault-ride through and ensures the reliability and security of the systems.
- 3) *Cost-Prioritized Droop Schemes*: All the optimization schemes are to reduce the cost, so it seems to more feasibly and effectively propose a droop scheme based on cost-prioritized. Reference [103] proposes several droop schemes in consideration of operating costs. These are nonlinear variable droop schemes which regard the related cost function as the droop coefficients.
- 4) *Variable Inertia*: The traditional bulk power system consists of many synchronous generators with a relatively large inertia. But microgrids do not have the kinetic energy and spinning reserve, which consist of many inverter-based distributed resources with a low inertia. Then, the low inertia may lead to severe voltage or frequency deviations in some big disturbances and sudden changes. So the system should show a large inertia when the frequency will deviate, and a low inertia when to recover the frequency. The objective of the variable inertia is always to keep the normal frequency.
- 5) *Stability Issues*: The stability of microgrid has been studied for long years. However, the stability of the microgrid has never been studied perfectly when it supplies some complex loads such as the dynamic loads, the constant loads, inductor motor, the pulsed loads, and the electric vehicles. So, it is necessary to propose the special models and control methods to solve the voltage, frequency, and power-angle stabilities for these composite loads.

VIII. CONCLUSION

This paper has presented an overview of the different power sharing control strategies of DGs in islanding ac microgrids. Detailed description of the control schemes has

been given. The communication-based methods of concentrated control, master/slave control, and distributed control perform a good current sharing, yet a low reliability and redundancy. However, the droop characteristic-based control method has been presented to avoid communication lines/cables, thus, which can help increase the system reliability, modularity, and flexibility. Also, improvement of virtual structure-based method, constructed- and compensated-based methods, common variable-based method, and signal injection method, have been proposed to overcome the inherent drawbacks of the traditional droop methods for decoupling the active and reactive control laws, robustness with respect to the system parameters, addressing nonlinear loads, and proper voltage regulation. Moreover, various control approaches are compared in terms of their respective advantages and disadvantages. Finally, the future trends for primary control techniques of ac microgrids are briefly discussed. The studies show that in the process of development of microgrid, challenges and opportunities coexist.

REFERENCES

- [1] K. Moslehi and R. Kumar, "A reliability perspective of the smart grid," *IEEE Trans. Smart Grid*, vol. 1, no. 1, pp. 57–64, Jun. 2010.
- [2] R. H. Lasseter, "Microgrids," in *Proc. IEEE Power Eng. Soc. Winter Meeting*, New York, NY, USA, 2002, pp. 305–308.
- [3] R. H. Lasseter and P. Paigi, "Microgrid: A conceptual solution," in *Proc. IEEE Power Electron. Spec. Conf.*, Aachen, Germany, 2004, pp. 4285–4290.
- [4] J. Rocabert, A. Luna, F. Blaabjerg, and P. Rodriguez, "Control of power converters in AC microgrids," *IEEE Trans. Power Electron.*, vol. 27, no. 11, pp. 4734–4739, Nov. 2012.
- [5] A. Molderink, V. Bakker, M. G. C. Bosman, J. L. Hurink, and G. J. M. Smit, "Management and control of domestic smart grid technology," *IEEE Trans. Smart Grid*, vol. 1, no. 2, pp. 109–119, Sep. 2010.
- [6] K. Debrabandere *et al.*, "A voltage and frequency droop control method for parallel inverters," *IEEE Trans. Power Electron.*, vol. 22, no. 4, pp. 1107–1115, Jul. 2007.
- [7] F. Blaabjerg, R. Teodorescu, M. Liserre, and A. V. Timbus, "Overview of control and grid synchronization for distributed power generation systems," *IEEE Trans. Ind. Electron.*, vol. 53, no. 5, pp. 1398–1409, Oct. 2006.
- [8] J. J. Justo, F. Mwasilu, and J. Lee, "AC microgrids versus DC microgrids with distributed energy resources: A review," *Renew. Sustain. Energy Rev.*, vol. 24, pp. 387–405, Aug. 2013.
- [9] M. A. Eltawil and Z. Zhao, "Grid-connected photovoltaic power systems: Technical and potential problems—A review," *Renew. Sustain. Energy Rev.*, vol. 14, no. 1, pp. 112–129, Jan. 2010.
- [10] Y. Li, D. M. Vilathgamuwa, and P. C. Loh, "Design, analysis, and real-time testing of a controller for multi-bus microgrid system," *IEEE Trans. Power Electron.*, vol. 19, no. 5, pp. 1195–1204, Sep. 2004.
- [11] P. Piagi and R. H. Lasseter, "Autonomous control of microgrids," in *Proc. Power Eng. Soc. Gen. Meeting*, Montreal, QC, Canada, 2006, pp. 8–15.
- [12] P. Arbolea, D. Diaz, and J. M. Guerrero, "An improved control scheme based in droop characteristic for microgrid converters," in *Proc. Elect. Power Syst. Res.*, Tokyo, Japan, 2010, pp. 1215–1221.
- [13] J. A. P. Lopes, C. L. Moreira, and A. G. Madureira, "Defining control strategies for microgrids islanded operation," *IEEE Trans. Power Syst.*, vol. 21, no. 2, pp. 916–924, May 2006.
- [14] F. Katiraei, M. R. Iravani, and P. W. Lehn, "Micro-grid autonomous operation during and subsequent to islanding process," *IEEE Trans. Power Del.*, vol. 20, no. 1, pp. 248–257, Jan. 2005.
- [15] N. Lidula and A. Rajapakse, "Microgrids research: A review of experimental microgrids and test systems," *Renew. Sustain. Energy Rev.*, vol. 15, no. 1, pp. 186–202, Jan. 2011.
- [16] M. C. Chandorkar, D. M. Divan, and R. Adapa, "Control of parallel connected inverters in standalone AC supply systems," *IEEE Trans. Ind. Appl.*, vol. 29, no. 1, pp. 136–143, Jan. 1993.

- [17] M. C. Chandrokar, D. M. Divan, and B. Blaabjerg, "Control of distributed UPS systems," in *Proc. 25th Annu. IEEE Power Electron. Spec. Conf.*, Taipei, Taiwan, 1994, pp. 197–204.
- [18] Y. B. Byun, T. G. Koo, and K. Y. Joe, "Parallel operation of three-phase UPS inverters by wireless load sharing control," in *Proc. Telecommun. Energy Conf.*, Phoenix, AZ, USA, 2000, pp. 526–532.
- [19] J. M. Guerrero, L. G. de Vicuña, and J. Matas, "Output impedance design of parallel-connected UPS inverters with wireless load-sharing control," *IEEE Trans. Ind. Electron.*, vol. 52, no. 4, pp. 1126–1135, Aug. 2005.
- [20] J. M. Guerrero, L. Hang, and J. Uceda, "Control of distributed uninterruptible power supply systems," *IEEE Trans. Ind. Electron.*, vol. 55, no. 8, pp. 2845–2859, Aug. 2008.
- [21] J. M. Guerrero, J. C. Vasquez, and J. Matas, "Control strategy for flexible microgrid based on parallel line-interactive UPS systems," *IEEE Trans. Ind. Electron.*, vol. 56, no. 3, pp. 726–736, Mar. 2009.
- [22] T. L. Vandoorn, J. D. M. De Kooning, and B. Meersman, "Review of primary control strategies for islanded microgrids with power-electronic interfaces," *Renew. Sustain. Energy Rev.*, vol. 19, pp. 613–628, Mar. 2013.
- [23] D. Shanzu, M. Yu, and X. Jian, "Parallel operation control technique of voltage source inverters in UPS," in *Proc. IEEE Int. Conf.*, Hong Kong, 1999, pp. 883–887.
- [24] M. Prodanovic, T. C. Green, and H. Mansir, "A survey of control methods for three-phase inverters in parallel connection," in *Proc. 8th Int. Conf. Power Electron. Variable Speed Drives*, London, U.K., 2000, pp. 472–477.
- [25] K. Siri, C. Q. Lee, and T. F. Wu, "Current distribution control for parallel connected converters. II," *IEEE Trans. Aerosp. Electron. Syst.*, vol. 28, no. 3, pp. 841–851, Jul. 1992.
- [26] T. F. Wu, K. Siri, and J. Banda, "The central-limit control and impact of cable resistance in current distribution for parallel-connected DC-DC converters," in *Proc. 25th Annu. IEEE Power Electron. Spec. Conf.*, Taipei, Taiwan, 1994, pp. 694–702.
- [27] J. Banda and K. Siri, "Improved central-limit control for parallel operation of DC-DC power converters," in *Proc. 26th Annu. IEEE Power Electron. Spec. Conf.*, Atlanta, GA, USA, 1995, pp. 1104–1110.
- [28] K. Siri, C. Q. Lee, and T. E. Wu, "Current distribution control for parallel connected converters. I," *IEEE Trans. Aerosp. Electron. Syst.*, vol. 28, no. 3, pp. 829–840, Jul. 1992.
- [29] J. F. Chen and C. L. Chu, "Combination voltage-controlled and current-controlled PWM inverters for UPS parallel operation," *IEEE Trans. Power Electron.*, vol. 10, no. 5, pp. 547–558, Sep. 1995.
- [30] F. Petruzzello, P. D. Ziogas, and G. Joos, "A novel approach to paralleling of power converter units with true redundancy," in *Proc. 21st Annu. IEEE Power Electron. Spec. Conf.*, San Antonio, TX, USA, 1990, pp. 808–813.
- [31] Y. Pei, G. Jiang, and X. Yang, "Auto-master-slave control technique of parallel inverters in distributed AC power systems and UPS," in *Proc. 35th Annu. IEEE Power Electron. Spec. Conf.*, Aachen, Germany, 2004, pp. 2050–2053.
- [32] J. Tan, H. Lin, and J. Zhang, "A novel load sharing control technique for paralleled inverters," in *Proc. 34th Annu. IEEE Power Electron. Spec. Conf.*, Acapulco, Mexico, 2003, pp. 1432–1437.
- [33] X. Sun, Y. S. Lee, and D. Xu, "Modeling, analysis, and implementation of parallel multi-inverter systems with instantaneous average current sharing scheme," *IEEE Trans. Power Electron.*, vol. 18, no. 3, pp. 844–856, May 2003.
- [34] J. He and Y. W. Li, "An enhanced microgrid load demand sharing strategy," *IEEE Trans. Power Electron.*, vol. 27, no. 9, pp. 3984–3995, Sep. 2012.
- [35] A. Tuladhar, H. Jin, and T. Unger, "Parallel operation of single phase inverter modules with no control interconnections," in *Proc. 12th Annu. IEEE Appl. Power Electron. Expo.*, Atlanta, GA, USA, 1997, pp. 94–100.
- [36] A. Tuladhar, H. Jin, and T. Unger, "Control of parallel inverters in distributed AC power systems with consideration of line impedance effect," *IEEE Trans. Ind. Appl.*, vol. 36, no. 1, pp. 131–138, Jan. 2000.
- [37] J. C. Vasquez, J. M. Guerrero, and A. Luna, "Adaptive droop control applied to voltage-source inverters operating in grid-connected and islanded modes," *IEEE Trans. Ind. Electron.*, vol. 56, no. 10, pp. 4088–4096, Oct. 2009.
- [38] Y. W. Li and C. N. Kao, "An accurate power control strategy for power-electronic-interfaced distributed generation units operating in a low-voltage multibus microgrid," *IEEE Trans. Power Electron.*, vol. 24, no. 12, pp. 2977–2988, Dec. 2009.
- [39] P. H. Divshali, A. Alimardani, and S. H. Hosseini, "Decentralized cooperative control strategy of microsources for stabilizing autonomous VSC-based microgrids," *IEEE Trans. Power Syst.*, vol. 24, no. 4, pp. 1949–1959, Nov. 2012.
- [40] F. Katiraei and M. R. Iravani, "Power management strategies for a microgrid with multiple distributed generation units," *IEEE Trans. Power Syst.*, vol. 21, no. 4, pp. 1821–1831, Nov. 2006.
- [41] E. A. A. Coelho, P. C. Cortizo, and P. F. D. Garcia, "Small-signal stability for parallel-connected inverters in stand-alone AC supply systems," *IEEE Trans. Ind. Appl.*, vol. 38, no. 2, pp. 533–542, Mar. 2002.
- [42] N. Pogaku, M. Prodanovic, and T. C. Green, "Modeling, analysis and testing of autonomous operation of an inverter-based microgrid," *IEEE Trans. Power Electron.*, vol. 22, no. 2, pp. 613–625, Mar. 2007.
- [43] R. Majumder, A. Ghosh, and G. Ledwich, "Angle droop versus frequency droop in a voltage source converter based autonomous microgrid," in *Proc. Power Energy Soc. Gen. Meeting*, Calgary, AB, Canada, 2009, pp. 1–8.
- [44] R. Majumder, B. Chaudhuri, and A. Ghosh, "Improvement of stability and load sharing in an autonomous microgrid using supplementary droop control loop," *IEEE Trans. Power Syst.*, vol. 25, no. 2, pp. 796–808, May 2010.
- [45] R. Majumder, G. Ledwich, and A. Ghosh, "Droop control of converter-interfaced microsources in rural distributed generation," *IEEE Trans. Power Del.*, vol. 25, no. 4, pp. 2768–2778, Oct. 2010.
- [46] J. M. Guerrero, J. Matas, and L. G. de Vicuña, "Decentralized control for parallel operation of distributed generation inverters using resistive output impedance," *IEEE Trans. Ind. Electron.*, vol. 54, no. 2, pp. 994–1004, Apr. 2007.
- [47] X. Yu, A. M. Khambadkone, and H. Wang, "Control of parallel-connected power converters for low-voltage microgrid—Part I: A hybrid control architecture," *IEEE Trans. Power Electron.*, vol. 25, no. 12, pp. 2962–2970, Dec. 2010.
- [48] C. K. Sao and P. W. Lehn, "Control and power management of converter fed microgrids," *IEEE Trans. Power Syst.*, vol. 23, no. 3, pp. 1088–1098, Aug. 2008.
- [49] T. L. Vandoorn, B. Meersman, and L. Degroote, "A control strategy for islanded microgrids with DC-link voltage control," *IEEE Trans. Power Del.*, vol. 26, no. 2, pp. 703–713, Apr. 2011.
- [50] T. L. Vandoorn, B. Renders, and L. Degroote, "Active load control in islanded microgrids based on the grid voltage," *IEEE Trans. Smart Grid*, vol. 2, no. 1, pp. 139–151, Mar. 2011.
- [51] T. L. Vandoorn, J. D. M. De Kooning, B. Meersman, J. M. Guerrero, and L. Vandeveldel, "Automatic power sharing modification of P/V droop controllers in low-voltage resistive microgrids," *IEEE Trans. Power Del.*, vol. 27, no. 4, pp. 2318–2325, Oct. 2012.
- [52] A. Moawwad, V. Khadkikar, and J. L. Kirtley, "A new P-Q-V droop control method for an interline photovoltaic (I-PV) power system," *IEEE Trans. Power Del.*, vol. 28, no. 2, pp. 658–668, Apr. 2013.
- [53] W. Yao, M. Chen, and J. Matas, "Design and analysis of the droop control method for parallel inverters considering the impact of the complex impedance on the power sharing," *IEEE Trans. Ind. Electron.*, vol. 58, no. 2, pp. 576–588, Feb. 2011.
- [54] J. C. Vasquez, J. M. Guerrero, and A. Luna, "Adaptive droop control applied to voltage-source inverters operating in grid-connected and islanded modes," *IEEE Trans. Ind. Electron.*, vol. 56, no. 10, pp. 4088–4096, Oct. 2009.
- [55] H. Hanaoka, M. Nagai, and M. Yanagisawa, "Development of a novel parallel redundant UPS," in *Proc. 25th Int. IEEE Telecommun. Energy Conf.*, Yokohama, Japan, 2003, pp. 493–498.
- [56] J. M. Guerrero, L. G. de Vicuña, and J. Matas, "A wireless controller to enhance dynamic performance of parallel inverters in distributed generation systems," *IEEE Trans. Power Electron.*, vol. 19, no. 5, pp. 1205–1213, Sep. 2004.
- [57] G. Yajuan, W. Weiyang, and G. Xiaoqiang, "An improved droop controller for grid-connected voltage source inverter in microgrid," in *Proc. 2nd IEEE Int. Symp. Power Electron. Distrib. Gener. Syst.*, Hefei, China, 2010, pp. 823–828.
- [58] Y. Mohamed and E. F. El-Saadany, "Adaptive decentralized droop controller to preserve power sharing stability of paralleled inverters in distributed generation microgrids," *IEEE Trans. Power Electron.*, vol. 23, no. 6, pp. 2806–2816, Nov. 2008.
- [59] A. M. Salamah, S. J. Finney, and B. W. Williams, "Autonomous controller for improved dynamic performance of AC grid, parallel-connected, single-phase inverters," *IET Gener. Transmiss. Distrib.*, vol. 2, no. 2, pp. 209–218, Mar. 2008.

- [60] T. Goya, E. Omine, and Y. Kinjo, "Frequency control in isolated island by using parallel operated battery systems applying H_∞ control theory based on droop characteristics," *IET Renew. Power Gener.*, vol. 5, no. 2, pp. 160–166, Mar. 2011.
- [61] J. M. Guerrero, J. C. Vasquez, and J. Matas, "Hierarchical control of droop-controlled AC and DC microgrids—A general approach toward standardization," *IEEE Trans. Ind. Electron.*, vol. 58, no. 1, pp. 158–172, Jan. 2011.
- [62] J. M. Guerrero, P. Loh, and M. Chandorkar, "Advanced control architectures for intelligent microgrids—Part I: Decentralized and hierarchical control," *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1254–1262, Apr. 2013.
- [63] J. He, Y. W. Li, and J. M. Guerrero, "An islanding microgrid power sharing approach using enhanced virtual impedance control scheme," *IEEE Trans. Power Electron.*, vol. 28, no. 11, pp. 5272–5282, Nov. 2013.
- [64] J. He and Y. W. Li, "Analysis, design, and implementation of virtual impedance for power electron," *IEEE Trans. Ind. Appl.*, vol. 47, no. 6, pp. 2525–2538, Nov./Dec. 2011.
- [65] C. T. Lee, C. C. Chuang, and C. C. Chu, "Control strategies for distributed energy resources interface converters in the low voltage microgrid," in *Proc. IEEE Energy Convers. Congr. Expo.*, San Jose, CA, USA, 2009, pp. 2022–2029.
- [66] Y. Li and Y. W. Li, "Decoupled power control for an inverter based low voltage microgrid in autonomous operation," in *Proc. IEEE 6th Int. Power Electron. Motion Control*, Wuhan, China, 2009, pp. 2490–2496.
- [67] Y. Li and Y. W. Li, "Virtual frequency-voltage frame control of inverter based low voltage microgrid," in *Proc. IEEE Elect. Power Energy Conf.*, Montreal, QC, Canada, 2009, pp. 1–6.
- [68] Y. Li and Y. W. Li, "Power management of inverter interfaced autonomous microgrid based on virtual frequency-voltage frame," *IEEE Trans. Smart Grid*, vol. 2, no. 1, pp. 30–40, Mar. 2011.
- [69] E. Rokrok and M. E. H. Golshan, "Adaptive voltage droop scheme for voltage source converters in an islanded multi-bus microgrid," *IET Gener. Transmiss. Distrib.*, vol. 4, no. 5, pp. 562–578, May 2010.
- [70] J. He and Y. W. Li, "An accurate reactive power sharing control strategy for DG units in a microgrid," in *Proc. IEEE 8th Int. Conf. Power Electron. (ECCE Asia)*, Jeju, Korea, 2011, pp. 551–556.
- [71] J. He and Y. W. Li, "An enhanced microgrid load demand sharing strategy," *IEEE Trans. Power Electron.*, vol. 27, no. 9, pp. 3984–3995, Sep. 2012.
- [72] C. T. Lee, C. C. Chu, and P. T. Cheng, "A new droop control method for the autonomous operation of distributed energy resource interface converters," in *Proc. IEEE Energy Convers. Congr. Expo.*, Atlanta, GA, USA, 2010, pp. 702–709.
- [73] C. T. Lee, C. C. Chu, and P. T. Cheng, "A new droop control method for the autonomous operation of distributed energy resource interface converters," *IEEE Trans. Power Electron.*, vol. 28, no. 4, pp. 1980–1993, Apr. 2013.
- [74] C. T. Lee, R. P. Jiang, and P. T. Cheng, "A grid synchronization method for droop controlled distributed energy resources converters," in *Proc. IEEE Energy Convers. Congr. Expo.*, Phoenix, AZ, USA, 2011, pp. 743–749.
- [75] C. K. Sao and P. W. Lehn, "Autonomous load sharing of voltage source converters," *IEEE Trans. Power Del.*, vol. 20, no. 2, pp. 1009–1016, Apr. 2005.
- [76] Q. C. Zhong, "Robust droop controller for accurate proportional load sharing among inverters operated in parallel," *IEEE Trans. Ind. Electron.*, vol. 60, no. 4, pp. 1281–1290, Apr. 2013.
- [77] D. J. Perreault, R. L. Selders, Jr., and J. G. Kassakian, "Frequency-based current-sharing techniques for paralleled power converters," *IEEE Trans. Power Electron.*, vol. 13, no. 4, pp. 626–634, Jul. 1998.
- [78] A. Bidram and A. Davoudi, "Hierarchical structure of microgrids control system," *IEEE Trans. Smart Grid*, vol. 3, no. 4, pp. 1963–1976, Dec. 2012.
- [79] E. Mojica-Nava, C. A. Macana, and N. Quijano, "Dynamic population games for optimal dispatch on hierarchical microgrid control," *IEEE Trans. Syst., Man, Cybern., Syst.*, vol. 44, no. 3, pp. 306–317, Mar. 2014.
- [80] L. Meng, F. Tang, M. Savaghebi, J. C. Vasquez, and J. M. Guerrero, "Tertiary control of voltage unbalance compensation for optimal power quality in islanded microgrids," *IEEE Trans. Energy Convers.*, vol. 29, no. 4, pp. 802–815, Dec. 2014.
- [81] F. Shahnia, R. P. S. Chandrasena, S. Rajakaruna, and A. Ghosh, "Primary control level of parallel distributed energy resources converters in system of multiple interconnected autonomous microgrids within self-healing networks," *IET Gener. Transmiss. Distrib.*, vol. 8, no. 2, pp. 203–222, Feb. 2014.
- [82] J. Bingnan and F. Yungsi, "Smart home in smart microgrid: A cost-effective energy ecosystem with intelligent hierarchical agents," *IEEE Trans. Smart Grid*, vol. 6, no. 1, pp. 3–13, Jan. 2015.
- [83] X. Wu, W. Xiuli, and Q. Chong, "A hierarchical framework for generation scheduling of microgrids," *IEEE Trans. Power Del.*, vol. 29, no. 6, pp. 2448–2457, Dec. 2014.
- [84] D. E. Olivares *et al.*, "Trends in microgrid control," *IEEE Trans. Smart Grid*, vol. 5, no. 4, pp. 1905–1919, Jul. 2014.
- [85] M. Yazdani and A. M. Sani, "Distributed control techniques in microgrids," *IEEE Trans. Smart Grid*, vol. 5, no. 6, pp. 2901–2909, Nov. 2014.
- [86] M. A. Shabani and Y. A.-R. I. Mohamed, "New family of microgrid control and management strategies in smart distribution grids—Analysis, comparison and testing," *IEEE Trans. Power Syst.*, vol. 29, no. 5, pp. 2257–2269, Sep. 2014.
- [87] B. M. Eid, N. A. Rahim, J. Selvaraj, and A. H. El Khateb, "Control methods and objectives for electronically coupled distributed energy resources in microgrids: A review," *IEEE Syst. J.*, to be published.
- [88] M. M. A. Abdelaziz, M. F. Shaaban, H. E. Farag, and E. F. El-Saadany, "A multistage centralized control scheme for islanded microgrids with PEV," *IEEE Trans. Sustain. Energy*, vol. 5, no. 3, pp. 927–937, Jul. 2014.
- [89] T. Caldognetto and T. Paolo, "Microgrids operation based on master-slave cooperative control," *IEEE J. Emerg. Sel. Topics Power Electron.*, vol. 2, no. 4, pp. 1081–1088, Dec. 2014.
- [90] Q. Shafiee, J. M. Guerrero, and V. C. Juan, "Distributed secondary control for islanded microgrids—A novel approach," *IEEE Trans. Power Electron.*, vol. 29, no. 2, pp. 1018–1031, Feb. 2014.
- [91] A. Bidram, A. Davoudi, and F. Lewis, "A multi-objective distributed control framework for islanded AC microgrids," *IEEE Trans. Ind. Informat.*, vol. 10, no. 3, pp. 1785–1798, Aug. 2014.
- [92] H. Xin, L. Zhang, Z. Wang, D. Gan, and K. P. Wong, "Control of island AC microgrids using a fully distributed approach," *IEEE Trans. Smart Grid*, vol. 6, no. 2, pp. 943–945, Mar. 2015.
- [93] M. A. Mahmud, M. J. Hossain, H. R. Pota, and A. M. T. Oo, "Robust nonlinear distributed controller design for active and reactive power sharing in islanded microgrids," *IEEE Trans. Energy Convers.*, vol. 29, no. 4, pp. 893–903, Dec. 2014.
- [94] J. Hu, J. Zhu, D. G. Dorrell, and J. M. Guerrero, "Virtual flux droop method—A new control strategy of inverters in microgrids," *IEEE Trans. Power Electron.*, vol. 29, no. 9, pp. 4704–4711, Sep. 2014.
- [95] M. Ashabani, Y. Mohamed, M. Mirsalim, and M. Aghashabani, "Multivariable droop control of synchronous current converters in weak grids/microgrids with decoupled dq -axes currents," *IEEE Trans. Smart Grid*, to be published.
- [96] L. Y. Lu and C. C. Chu, "Consensus-based droop control synthesis for multiple DICs in isolated micro-grids," *IEEE Trans. Power Syst.*, to be published.
- [97] X. Yu, A. M. Khambadkone, and H. H. Wang, "A hybrid control architecture for low voltage microgrid," in *Proc. IEEE Energy Convers. Congr. Expo.*, Atlanta, GA, USA, 2010, pp. 3161–3168.
- [98] Y. Zhang and H. Ma, "Theoretical and experimental investigation of networked control for parallel operation of inverters," *IEEE Trans. Ind. Electron.*, vol. 59, no. 4, pp. 1961–1970, Apr. 2012.
- [99] M. N. Marwali, J. W. Jung, and A. Keyhani, "Control of distributed generation systems—Part II: Load sharing control," *IEEE Trans. Power Electron.*, vol. 19, no. 6, pp. 626–634, Nov. 2004.
- [100] H. Hua, L. Yao, S. Yao, S. Mei, and J. M. Guerrero, "An improved droop control strategy for reactive power sharing in islanded microgrid," *IEEE Trans. Power Electron.*, vol. 30, no. 6, pp. 3133–3141, Jun. 2014.
- [101] A. Kahrobaei and Y. A.-R. I. Mohamed, "Networked based hybrid distributed power sharing and control for islanded micro-grid systems," *IEEE Trans. Power Electron.*, vol. 30, no. 2, pp. 603–617, Feb. 2015.
- [102] A. Vargas-Martínez, L. I. A. Minchala, Y. Zhang, L. E. Garza-Castañón, and H. Badihi, "Hybrid adaptive fault-tolerant control algorithms for voltage and frequency regulation of an islanded microgrid," *Int. Trans. Electron. Energy Syst.*, vol. 25, no. 5, pp. 827–844, Jan. 2014.
- [103] I. U. Nutkani, P. C. Loh, and F. Blaabjerg, "Cost-prioritized droop schemes for autonomous AC microgrids," *IEEE Trans. Power Electron.*, vol. 30, no. 2, pp. 1109–1119, Feb. 2015.




Hua Han received the B.S. degree in geophysical engineering, and the M.S. and Ph.D. degrees in control science and engineering from Central South University, Changsha, China, in 1993, 1998, and 2008, respectively.

In 2011, she was a Visiting Scholar with the University of Central Florida, Orlando, FL, USA, for one year. She is currently an Associate Professor with the School of Information Science and Engineering. Her current research interests include microgrid and power electronic equipment.



Mei Su received the B.S. degree in automation, and the M.S. and Ph.D. degrees in control science and engineering from Central South University, Changsha, China, in 1989, 1992, and 2005, respectively.

Since 2006, she has been a Professor with the School of Information Science and Engineering. Her current research interests include matrix converter, adjustable speed drives, and wind energy conversion system.



Xiaochao Hou received the B.S. degree in automation from Central South University, Changsha, China, in 2014, where he is currently pursuing the M.S. degree in electrical engineering.

His current research interests include renewable energy systems, distributed generation, and microgrid.



Jian Yang (M'09) received the Ph.D. degree in electrical engineering from the University of Central Florida, Orlando, FL, USA, in 2008.

He was a Senior Electrical Engineer with Delta Tau Data Systems, Inc., Los Angeles, CA, USA, from 2007 to 2010. Since 2011, he has been with Central South University, Changsha, China, where he is currently an Associate Professor with the School of Information Science and Engineering. His current research interests include control application, motion planning, and power electronics.



Jifa Wu received the B.S. degree in automation, and the M.S. degree in control science and engineering from Central South University, Changsha, China, in 2006 and 2009, respectively, where he is currently pursuing the Ph.D. degree in electrical engineering.

His current research interests include photovoltaic power generation system and wind energy conversion system.



Josep M. Guerrero (S'01–M'04–SM'08–F'15) received the B.S. degree in telecommunications engineering, the M.S. degree in electronics engineering, and the Ph.D. degree in power electronics from the Technical University of Catalonia, Barcelona, Spain, in 1997, 2000, and 2003, respectively.

Since 2011, he has been a Full Professor with the Department of Energy Technology, Aalborg University, Aalborg, Denmark, where he is responsible for the Microgrid Research Program. Since 2012, he has been a Guest Professor with the

Chinese Academy of Science, Beijing, China, and the Nanjing University of Aeronautics and Astronautics, Nanjing, China. Since 2014, he has been the Chair Professor with Shandong University, Jinan, China. His current research interests include different microgrid aspects, such as power electronics, distributed energy storage systems, hierarchical and cooperative control, energy management systems, and optimization of microgrids and islanded minigrids.

Prof. Guerrero was a recipient of ISI Highly Cited Researcher Award in 2014. He is an Associate Editor of the IEEE TRANSACTIONS ON POWER ELECTRONICS, the IEEE TRANSACTIONS ON INDUSTRIAL ELECTRONICS, and the IEEE INDUSTRIAL ELECTRONICS MAGAZINE, and an Editor of the IEEE TRANSACTIONS ON SMART GRID. He was a Guest Editor of the IEEE TRANSACTIONS ON POWER ELECTRONICS Special Issues on Power Electronics for Wind Energy Conversion and Power Electronics for Microgrids; the IEEE TRANSACTIONS ON INDUSTRIAL ELECTRONICS Special Sections on Uninterruptible Power Supplies Systems, Renewable Energy Systems, Distributed Generation and Microgrids, and Industrial Applications and Implementation Issues of the Kalman Filter; and the IEEE TRANSACTIONS ON SMART GRID Special Issue on Smart DC Distribution Systems. He was the Chair of the Renewable Energy Systems Technical Committee of the IEEE Industrial Electronics Society.